


"M" SHALL BE ONE NOMINAL
SIZE SMALLER THAN "N"

MINIMUM "N" & "M" IS 8"

NOTE DROP ASSEMBLIES
ARE REQUIRED WHERE
THE FALL ACROSS THE
MANHOLE IS GREATER
THAN 15". IF UNDER 15',
SEE S-4A.

SEE DRAWING S-4
FOR DETAIL OF
PIPE AT WALL

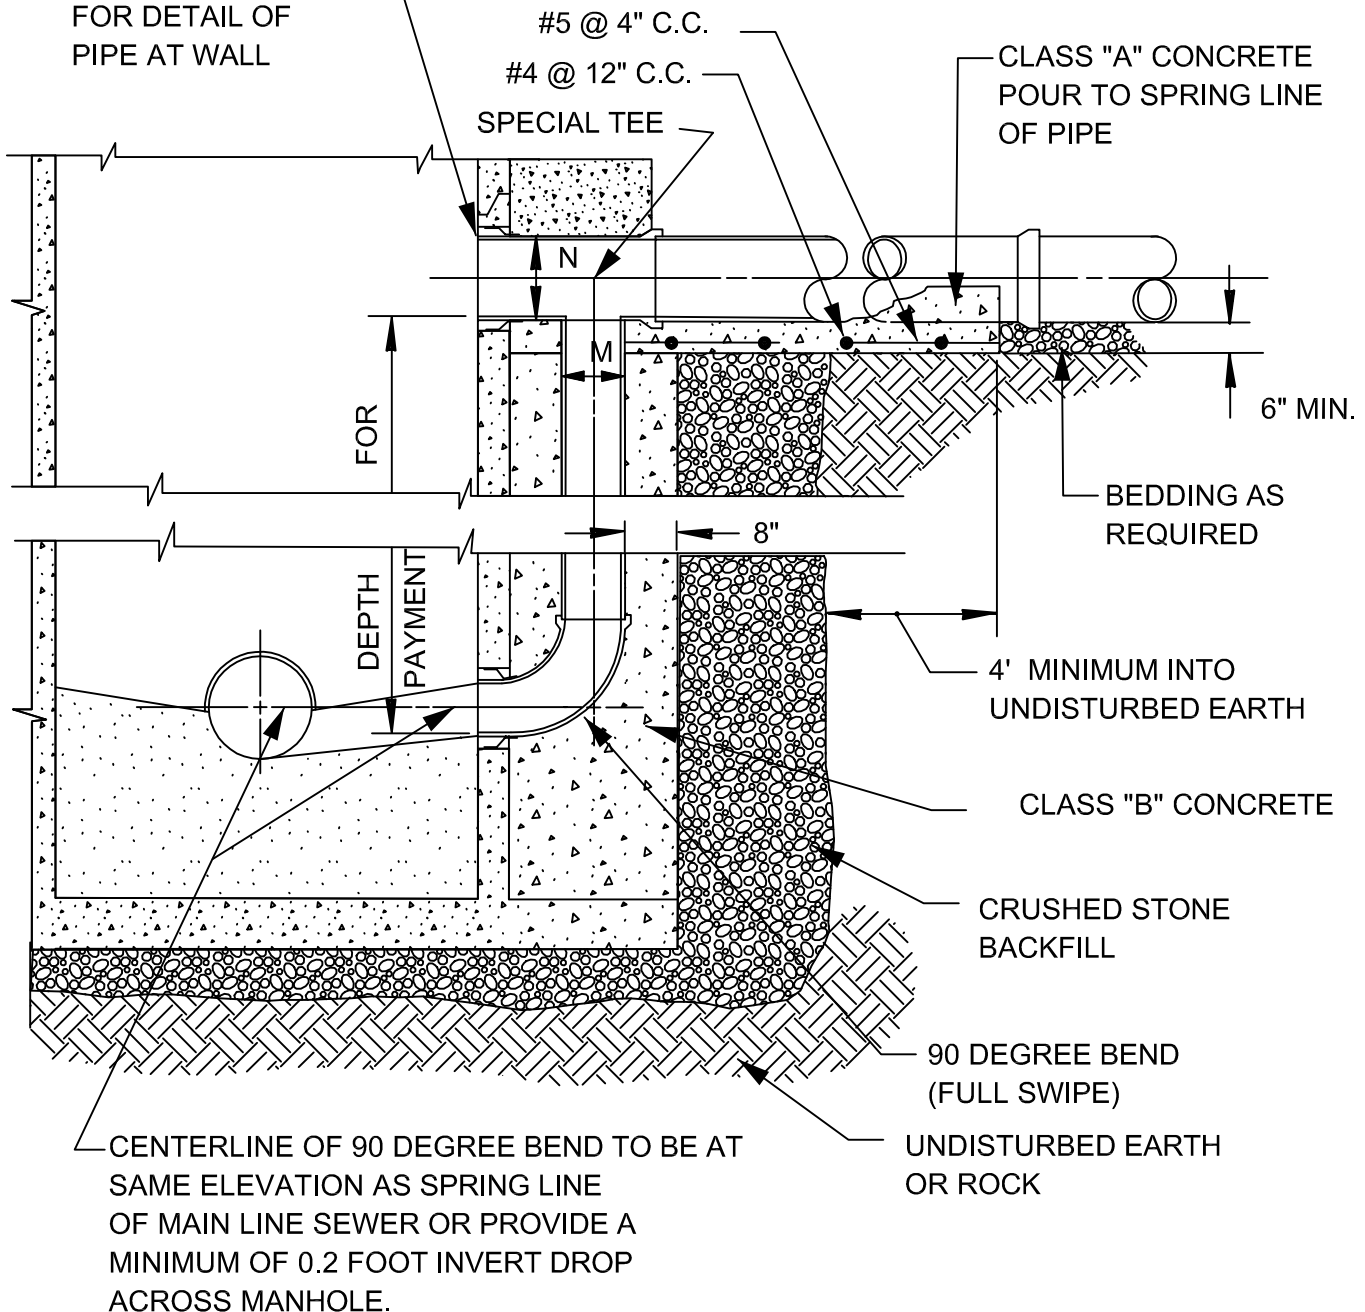

DRAWING NOT TO SCALE

MAY 27, 1994

DRAWN BY: A.H.W.F.

APPROVED BY: K.N.H.

DATE REVISED: 3/5/02 KMC 12/30/08 KAC

MANHOLE DROP CONNECTION

STANDARD
DRAWING NO.

S - 10

MURFREESBORO WATER & SEWER DEPARTMENT